

Wind Loading on Parabolic Trough Collectors: Wind and Structural Loads Measurements at an Operational Powerplant

Ulrike Egerer, Scott Dana, Geng Xia, Brooke J. Stanislawski and Shashank Yellapantula
July 10, 2023



Outline

1. Motivation and Measurement Setup
2. Case Study: Wind Conditions and Support Structure Loads
3. Comparison of Load Coefficients to Wind Tunnel Tests
4. Impact Factors on Dynamic Loads

1. Motivation: Wind Loading on Parabolic Troughs

Background

- Wind loading is one of **the primary drivers of structural design costs** of concentrated solar power (CSP) collector structures.
- To date, the design of these structures **has relied on data from wind tunnels** that do not adequately capture the **dynamic effects** observed at scale.
- **Field measurements at a full-scale operational power plant** will help to better understand wind loading on collector structures.

Parabolic Trough Measurement Campaign



The NREL team collects detailed characterization of prevailing wind and turbulence conditions and resulting operational loads on parabolic troughs in a full-scale CSP plant.




Parabolic trough rows at the **Nevada Solar One (NSO)** solar power plant with damaged mirrors on the outer edge of the field. *Photos by Ulrike Egerer, NREL*

Methods: Wind and Turbulence Measurements

Wind and turbulence measurements at the Nevada Solar One (NSO) power plant
November 2021–June 2023

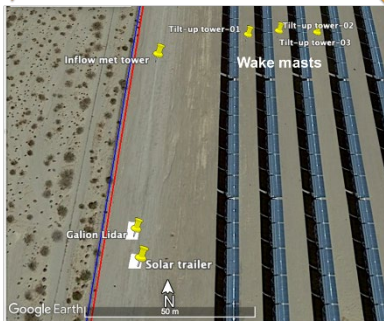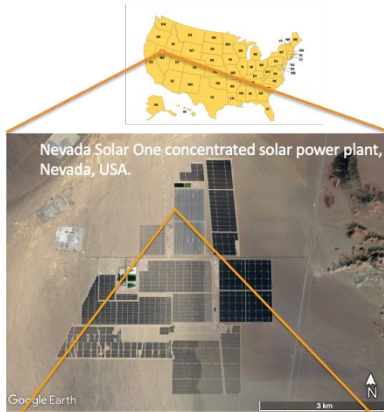


Images from Google Earth

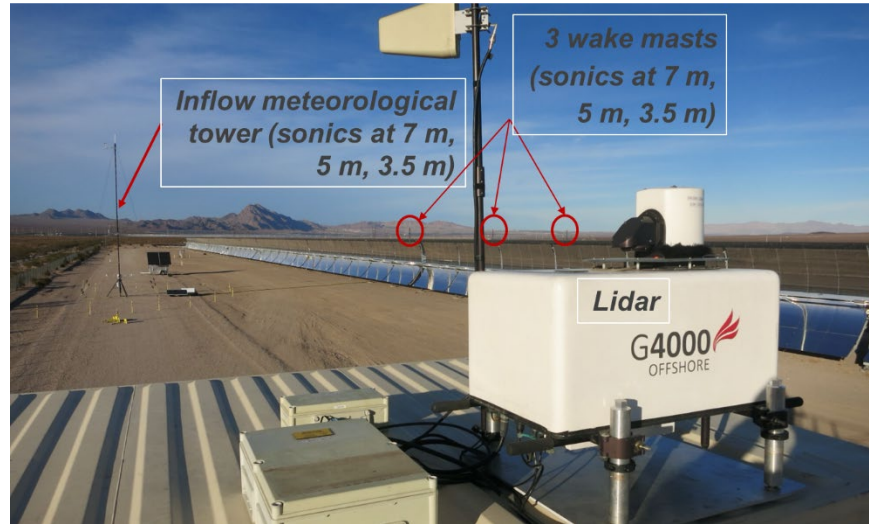


Sonic anemometers within and above the trough field at the inflow mast and wake masts. *Photo by Dave Jager, NREL*

Inflow wind characterization

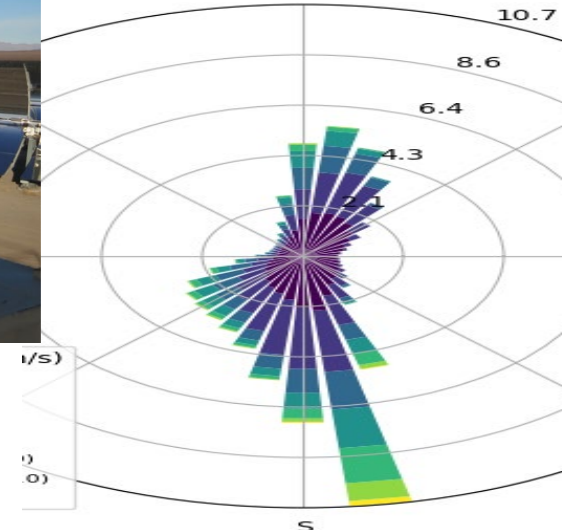

Methods: Structural Loads Measurements

Additional structural loads measurements at NSO: November 2022–June 2023

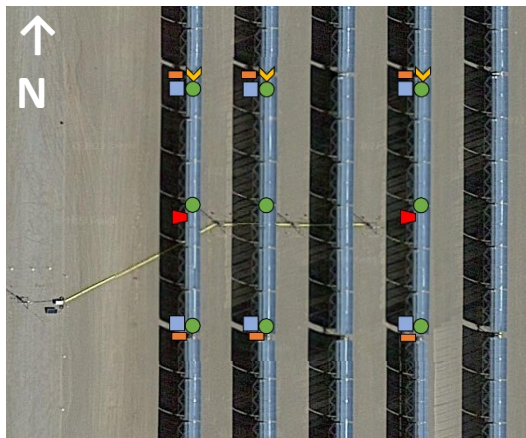


- Drive Torque
- Pylon Bending
- Dynamic Tilt
- Accelerations
- ▲ Mirror Vibration




Photo by Ulrike Egerer, NREL

2. Case Study: Support Structure Loads Are Driven by Wind Speed, Direction, and Row Position

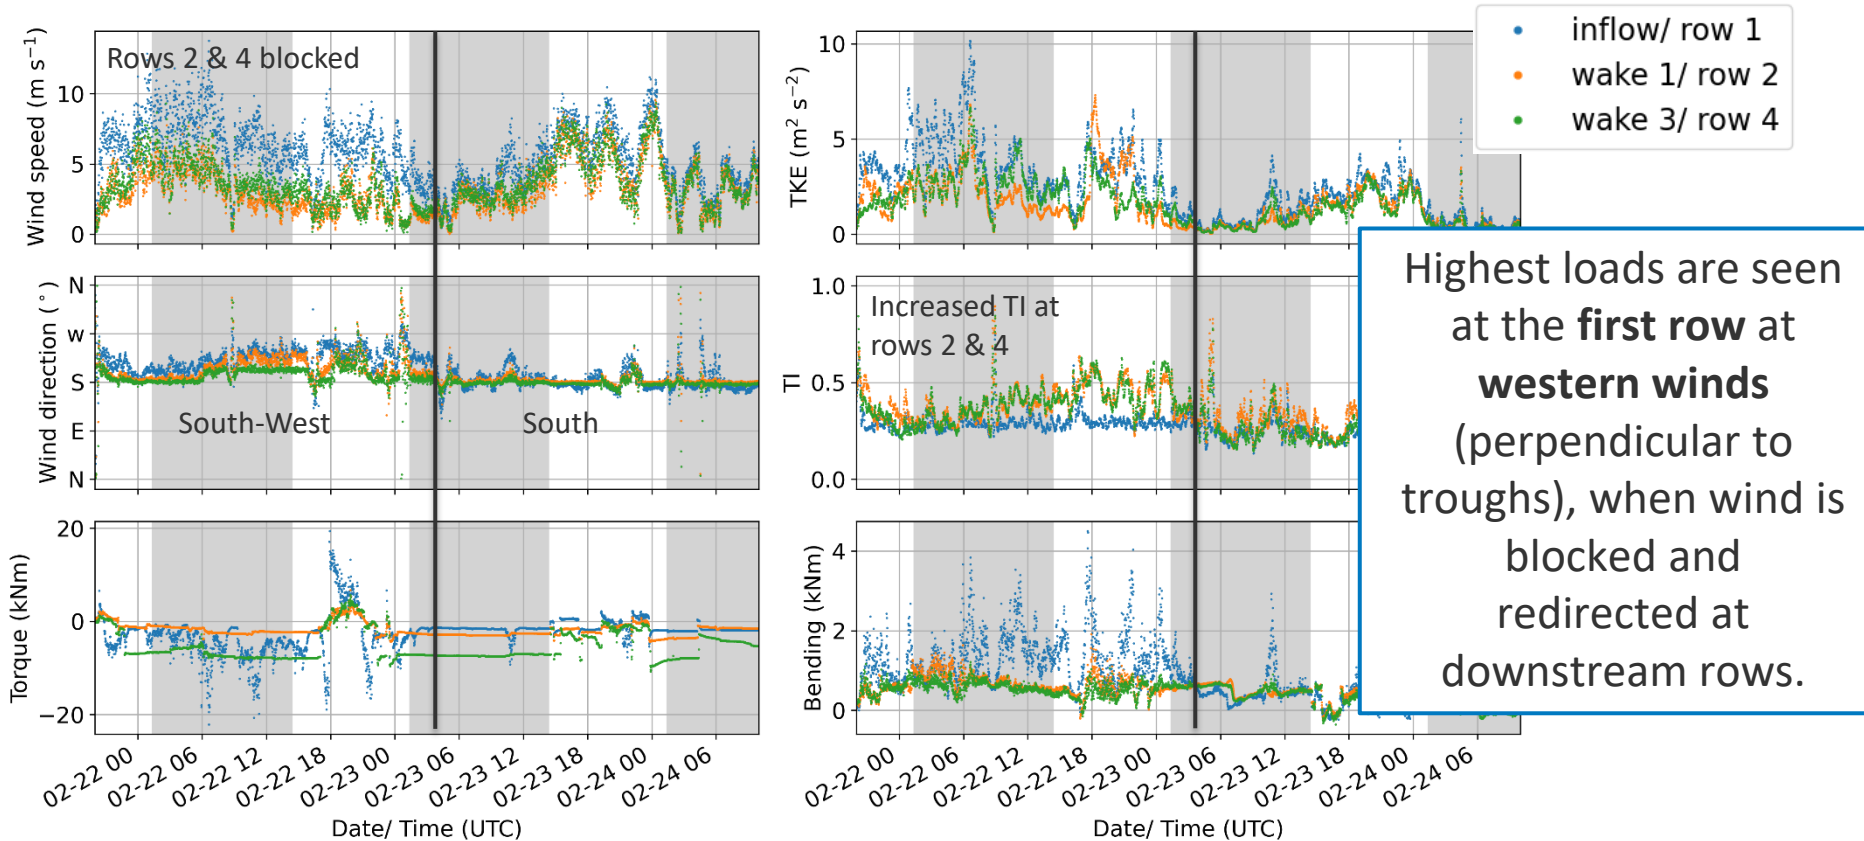

3. Support Structure Loads: Comparison to Wind Tunnel

Hosoya et al. (2008): Comprehensive wind tunnel tests

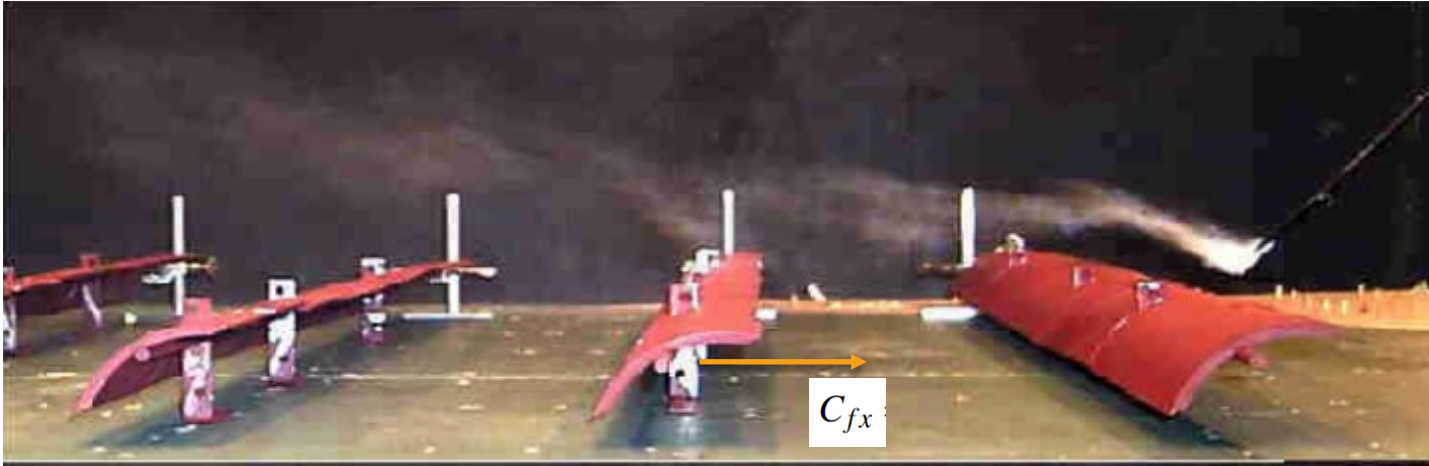

Drag force coefficient:


$$C_{fx} = \frac{F_x}{\frac{\rho}{2} U^2 \cdot L_{\text{segment}} \cdot W}$$

F_x Drag force
 U Mean wind speed
 L_{segment} Length of trough segment
 W Aperture width

Support Structure Loads: Comparison of NSO Dataset to Wind Tunnel Tests

Drag force coefficient:


$$C_{fx} = \frac{F_x}{\frac{\rho}{2} U^2 \cdot L_{\text{segment}} \cdot W}$$

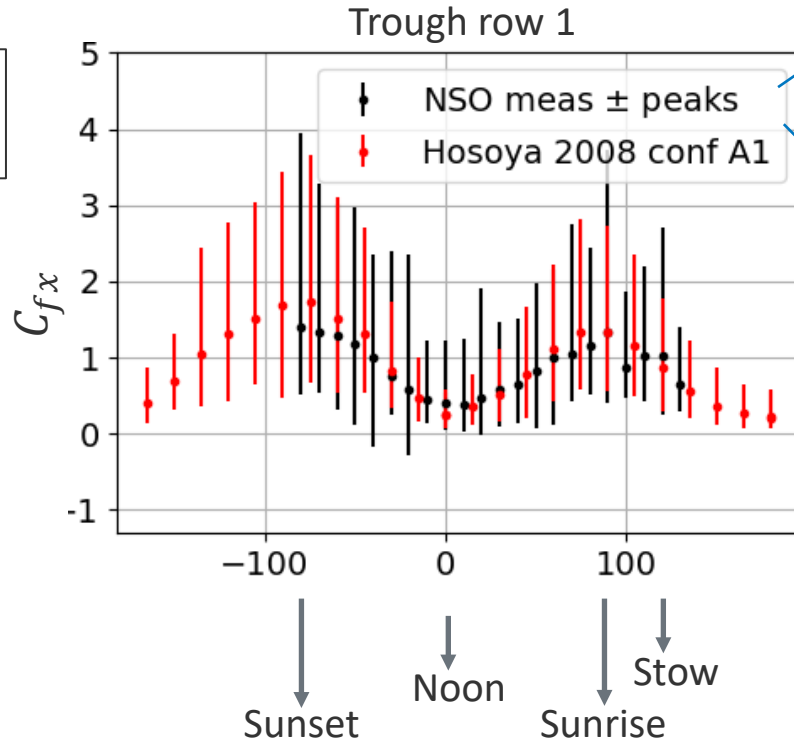

NSO: mean ± **peak loads** (wind direction: 260°–280°)

Hosoya et al. (2008): mean ± **peak loads** (0° yaw)

Support Structure Loads: Comparison to Wind Tunnel

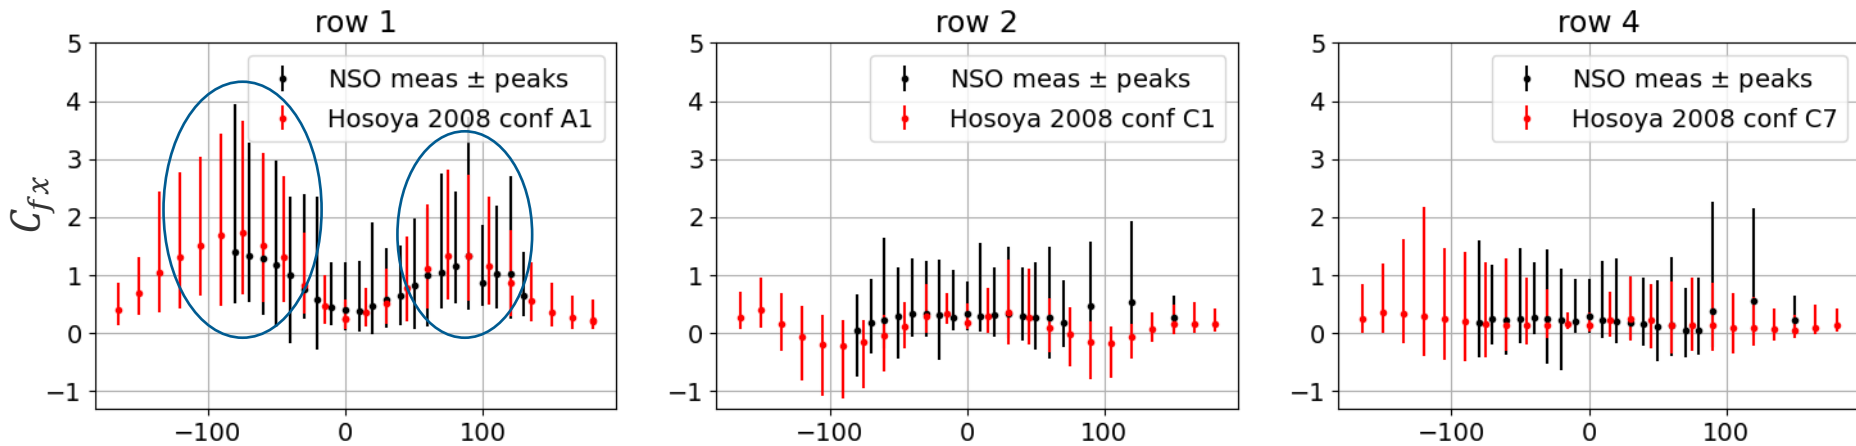


- Basic patterns for static loads agree well with wind tunnel results.
- NSO measurements show **higher peak loads** than wind tunnel tests.
- The first row experiences the highest static and **dynamic loads**, despite the higher TI at downstream rows.

4. Impact Factors on Dynamic Loads

What causes high dynamic loads on full-scale CSP structures?


Probable impact factors are trough angle, high winds, high TKE or TI, specific length scales L_w .

Jafari et al. (2019) introduced a **turbulence parameter η** (for heliostats) to describe peak lift coefficients.

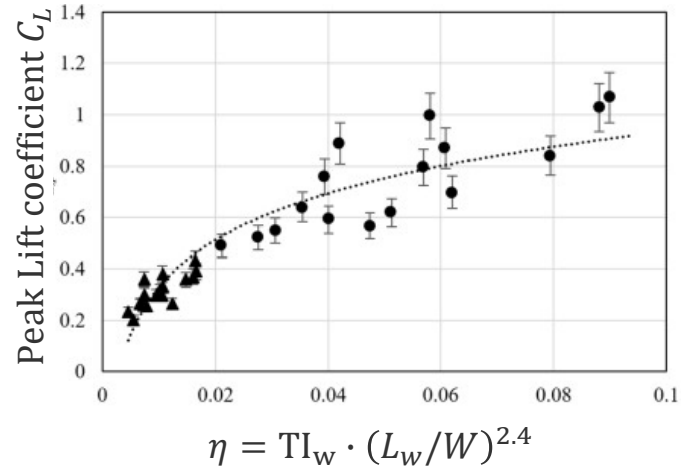

Jafari Azadeh, Farzin Ghanadi, Maziar Arjomandi, Matthew J. Emes, and Benjamin S. Cazzolato. 2019. Correlating Turbulence Intensity and Length Scale With the Unsteady Lift Force on Flat Plates in an Atmospheric Boundary Layer Flow. *Journal of Wind Engineering and Industrial Aerodynamics* 189 (June 2019): 218–230. <https://doi.org/10.1016/j.jweia.2019.03.029>.

Impact Factors on Dynamic Loads (first row)

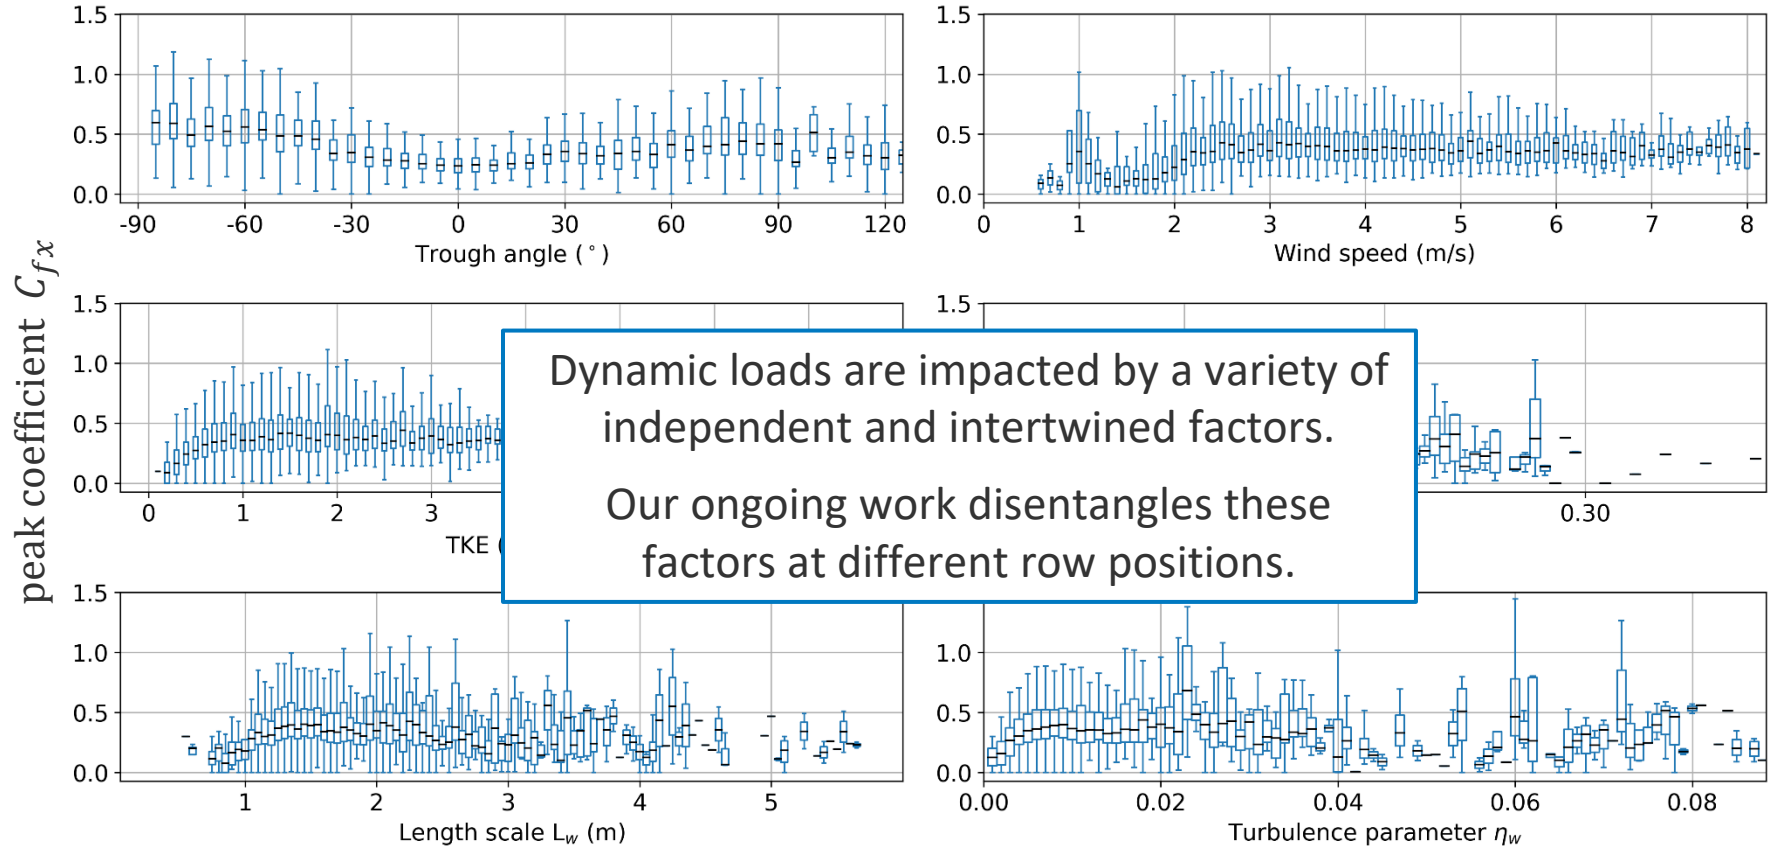

Summary

Key Messages

- **First-of-its-kind, long-term data set from an operational parabolic trough plant** sheds light on wind-structural load interactions.
- Static load observations **align with previous wind tunnel tests**, while dynamic loads show differences.
- Ongoing research aims to identify **key factors contributing to high dynamic loads** on collector structures.

Thank you!

ulrike.egerer@nrel.gov

NREL/PR-5000-86671

This work was authored in part by the National Renewable Energy Laboratory, operated by Alliance for Sustainable Energy, LLC, for the U.S. Department of Energy (DOE) under Contract No. DE-AC36-08GO28308. Funding provided by U.S. Department of Energy Office of Energy Efficiency and Renewable Energy Solar Energy Technologies Office. The views expressed in the article do not necessarily represent the views of the DOE or the U.S. Government. The U.S. Government retains and the publisher, by accepting the article for publication, acknowledges that the U.S. Government retains a nonexclusive, paid-up, irrevocable, worldwide license to publish or reproduce the published form of this work, or allow others to do so, for U.S. Government purposes.

